


Badger Army Ammunition Plant

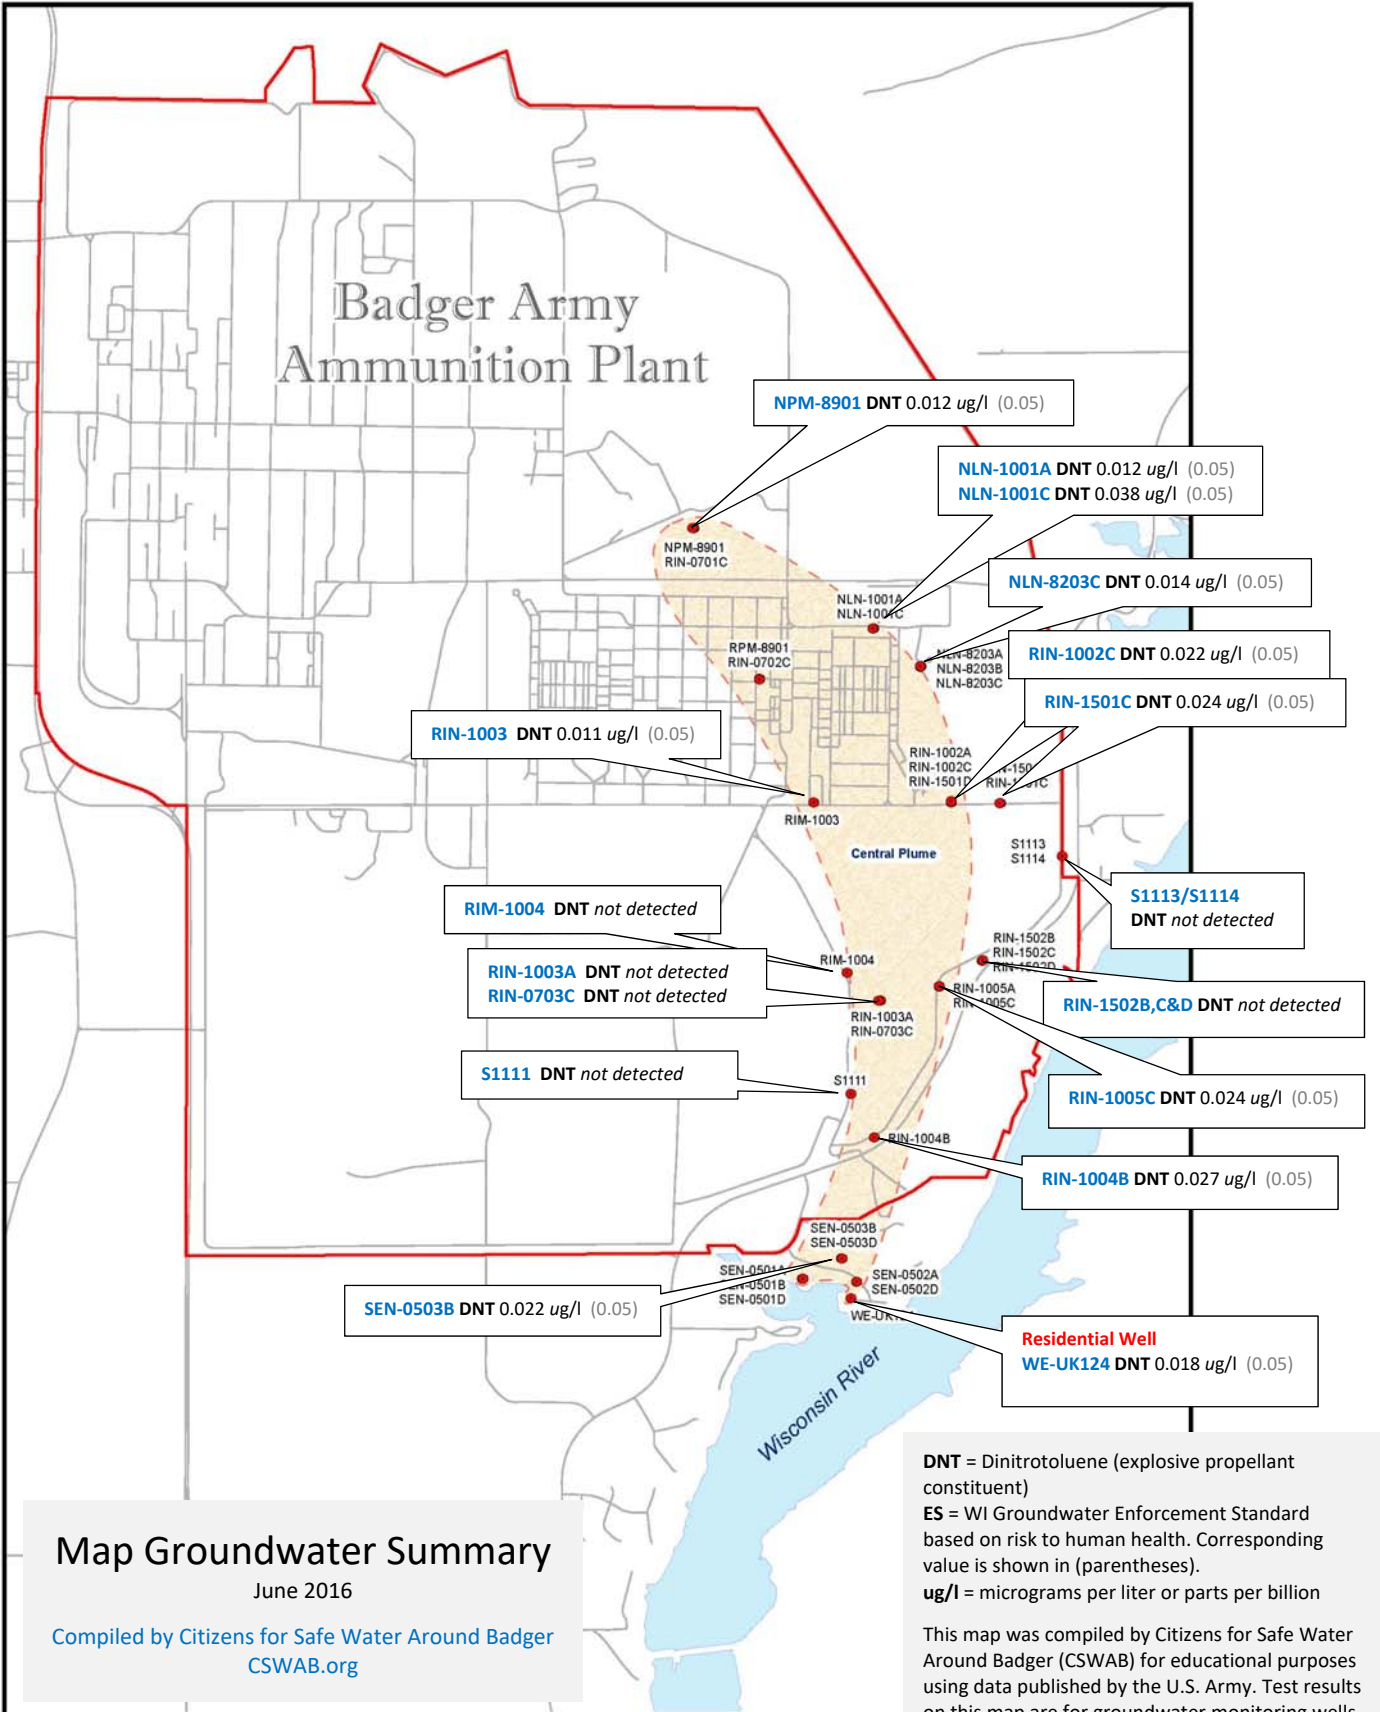

DNT = Dinitrotoluene (explosive propellant constituent)
ES = WI Groundwater Enforcement Standard based on risk to human health. Corresponding value is shown in (parentheses).
ug/l = micrograms per liter or parts per billion

This map was compiled by Citizens for Safe Water Around Badger (CSWAB) for educational purposes using data published by the U.S. Army. Test results on this map are for groundwater monitoring wells only, not drinking water wells. Not all wells shown were tested, and not all exceedances are shown.

Letter designations on well names indicate relative well depths. Progression from "A" to "E" indicates increasing depth, with "A" wells being the shallowest.

June 2016 Sampled Wells Badger Army Ammunition Plant

- Sampled Well
- Groundwater Plume

