


Badger Army Ammunition Plant

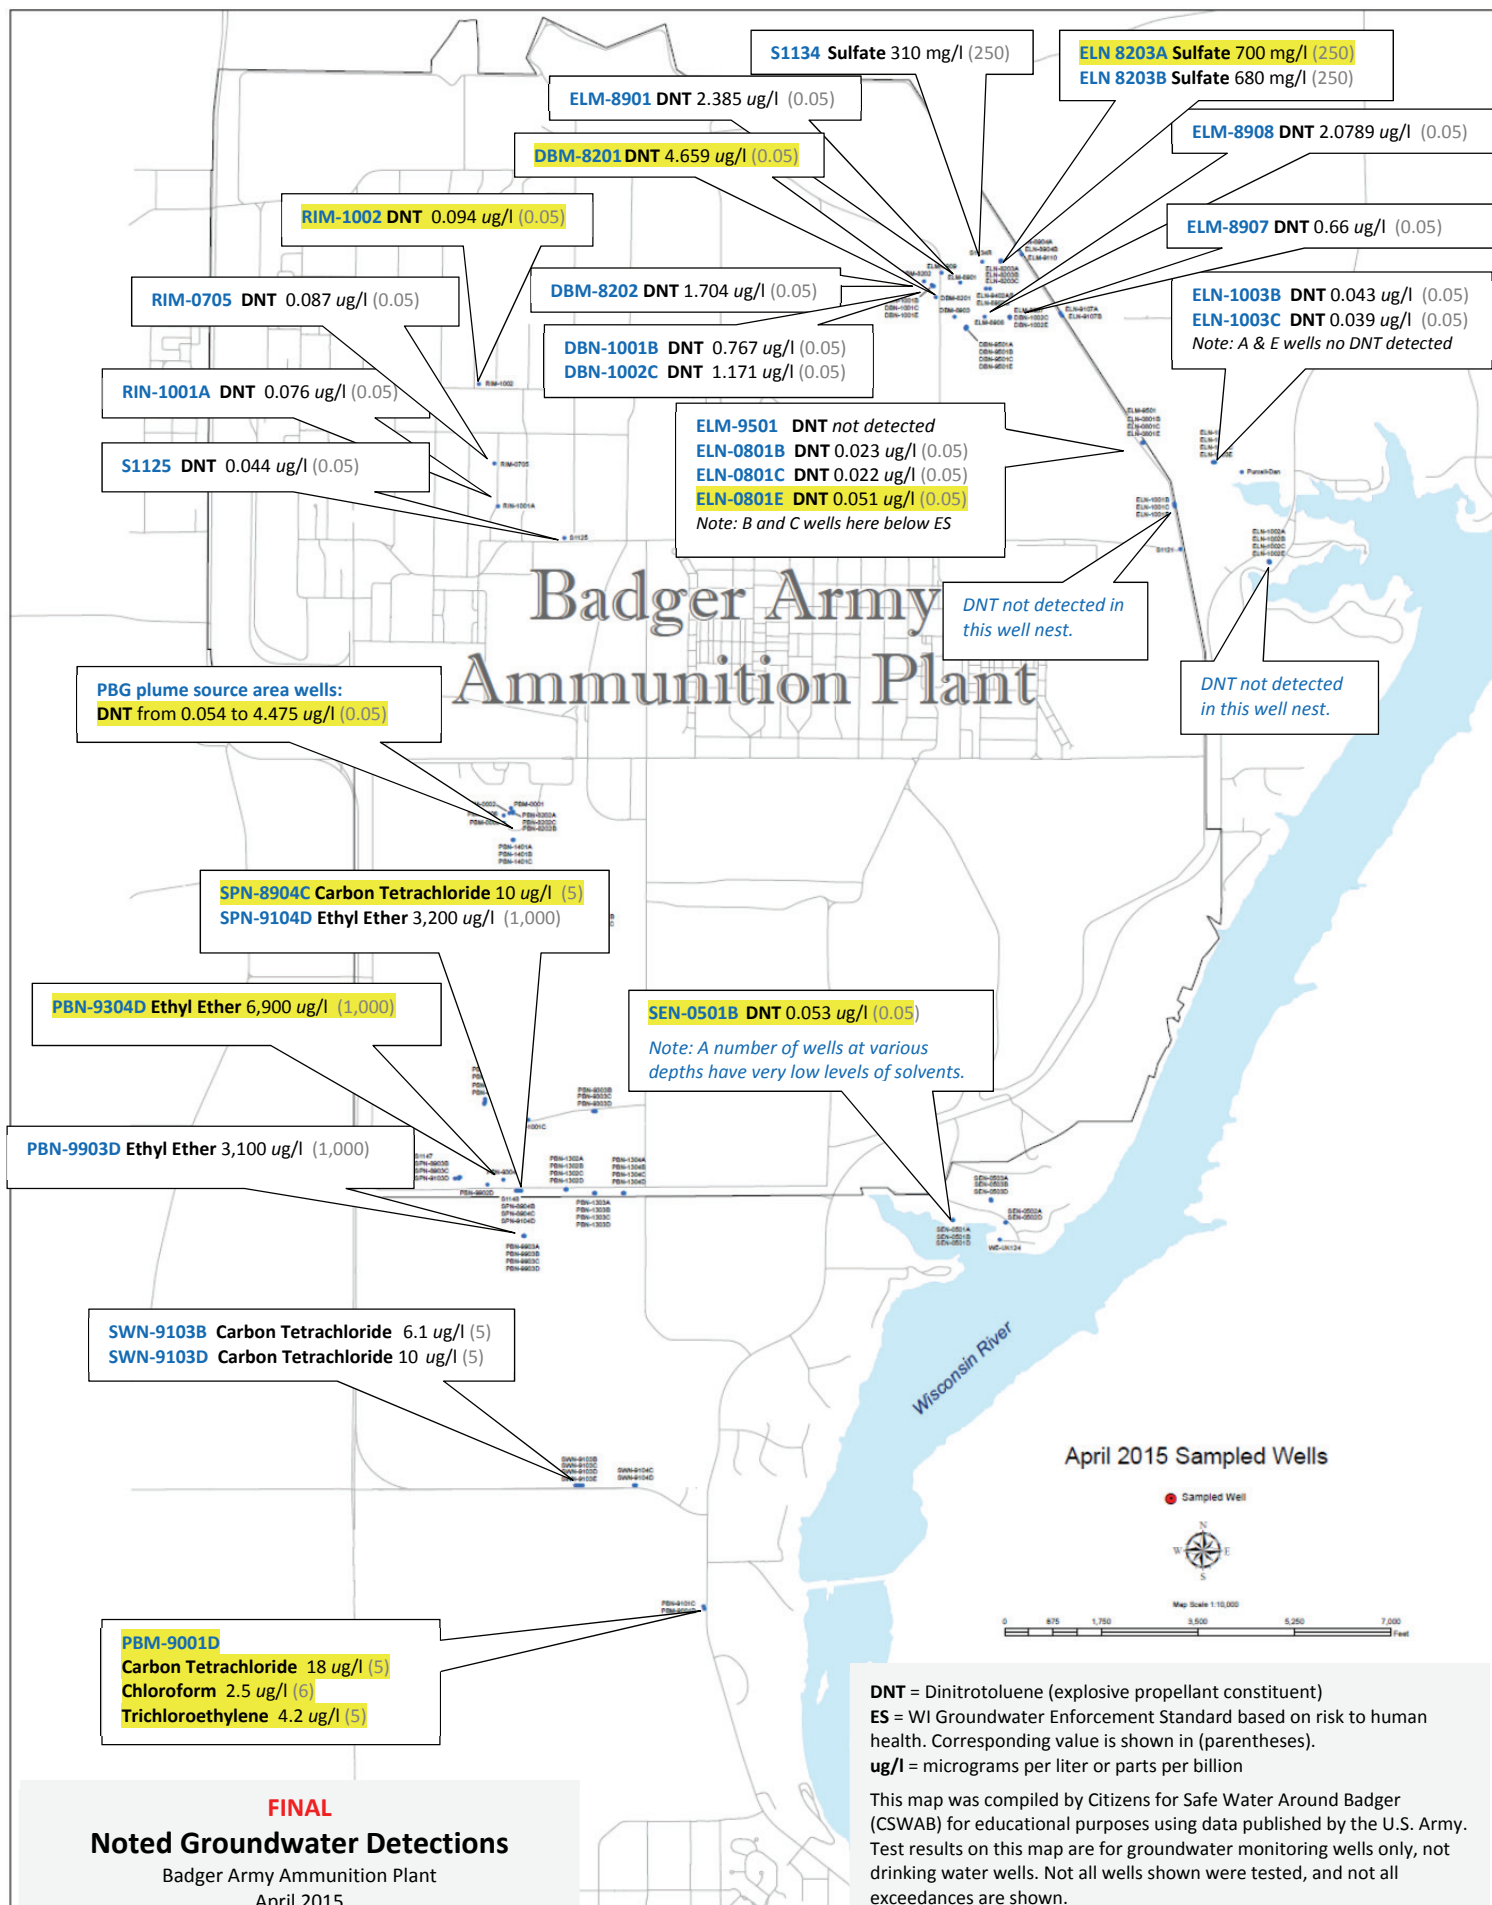

FINAL
Noted Groundwater Detections
 Badger Army Ammunition Plant
 April 2015
 Compiled by Citizens for Safe Water Around Badger
 CSWAB.org

DNT = Dinitrotoluene (explosive propellant constituent)
ES = WI Groundwater Enforcement Standard based on risk to human health. Corresponding value is shown in parentheses.
ug/l = micrograms per liter or parts per billion

This map was compiled by Citizens for Safe Water Around Badger (CSWAB) for educational purposes using data published by the U.S. Army. Test results on this map are for groundwater monitoring wells only, not drinking water wells. Not all wells shown were tested, and not all exceedances are shown.

Letter designations on well names indicate relative well depths. Progression from "A" to "E" indicates increasing depth, with "A" wells being the shallowest.